



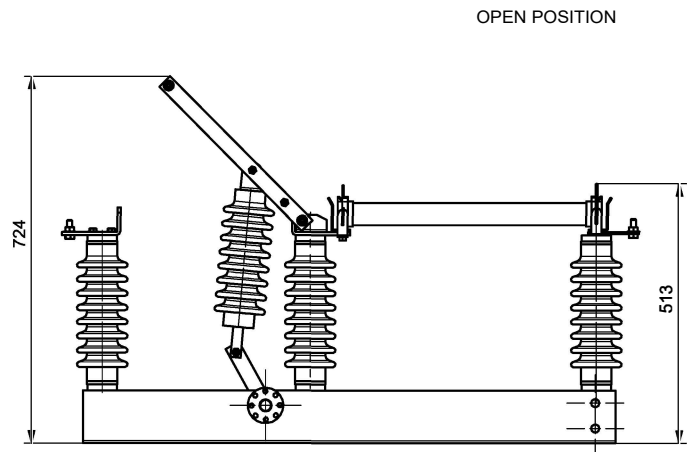

SYM	REVISION RECORD		
①			

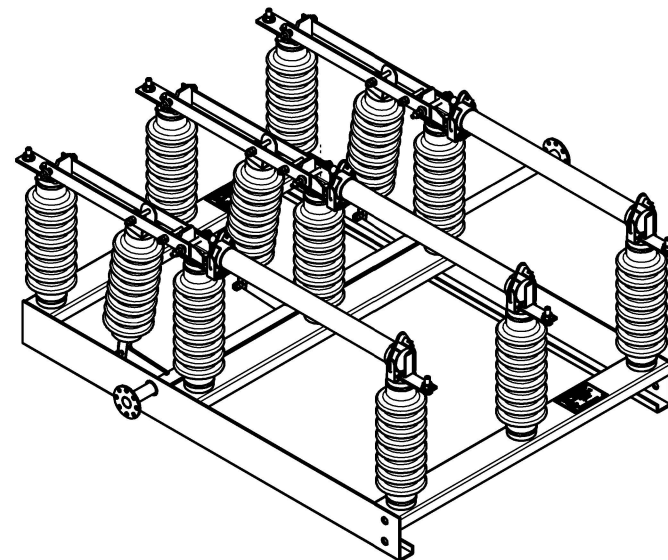

- RATE VOLTAGE: 24 KV
- NUMBER OF SHED: 8 SHED
- LEAKAGE DISTANCE: 550mm
- CABLE SCREW: M10
- HOLES BASE DISTANCE: 830x720 mm
- PHASE TO PHASE DISTANCE: 335 mm

THU TU (NO)	SO SAN PHAM (PART NO)		MA SO (ASPI)	TEN SAN PHAM (PART NAME)		SO LUONG (QTY)	SO SAN PHAM CUA KHACH HANG (CUSTOMER PART NO)	
AN TOAN (SAFETY)	CUNG CAP (SUPPLY)		MO HINH (MODEL)	KHACH HANG (CUSTOMER)		VAT LIEU (MATERIAL)	TRONG LUONG (MASS)	DON V (UNIT)
	-		NEW			-	-	KG
DISCONNECTOR SWITCH WITH FUSE BASE							NOTE	
TEN SAN PHAM (PART NAME)							SỬ GỒM	
THUC HIEU (DRAWN)	THIET KE (DESIGNED)	KIEM TRA (CHECKED)	PHIE CHUAN (APPROVED)	TY LE (SCALE)	HỌ TÊN KHÁCH HÀNG			
				1:5	CUSTOMER PART NO			
					PART NO			FORM SHEET
VIUONG_X.CUONG	VIUONG_X.CUONG	VIUONG_X.DONG	VIUONG_X.DONG					
 NPC JOINT STOCK COMPANY				CO DIAY (OR SIZE)	MA SO (CODE-AP)	KIEU (TYPE)	NHIEU LUYEN HEAT TREATMENT	MA (SURFACE TREATMENT)
				A2	A	TRONG NHÀ	-	-